

VIPA System MICRO

PS | M07-2BA00 | Manual

HB400 | PS | M07-2BA00 | en | 20-02

Power supply - PS M07



YASKAWA Europe GmbH Ohmstraße 4 91074 Herzogenaurach

Tel.: +49 9132 744 0 Fax: +49 9132 744 186

Email: info@yaskawa.eu.com Internet: www.yaskawa.eu.com

Table of contents

| 1 | General | 4 |
|---|--------------------------------------|-----|
| | 1.1 Copyright © YASKAWA Europe GmbH | . 4 |
| | 1.2 About this manual | . 6 |
| | 1.3 Safety instructions | . 7 |
| 2 | Basics and mounting | . 8 |
| | 2.1 Safety information for users | . 8 |
| | 2.2 System conception | . 9 |
| | 2.3 Dimensions | 10 |
| | 2.4 Mounting | 12 |
| | 2.4.1 Mounting without mounting rail | 13 |
| | 2.4.2 Mounting with mounting rail | 13 |
| | 2.5 Wiring | 15 |
| | 2.5.1 Wiring power supply | 15 |
| | 2.6 Demounting | 16 |
| | 2.7 Installation guidelines | 19 |
| | 2.8 General data | 21 |
| 3 | Power supply | 23 |
| | 3.1 Safety instructions | 23 |
| | 3.2 PS M07 DC24V, 1.5A_AC120V-240V | 24 |
| | 3.3 Technical data | 27 |
| | Appendix | 29 |
| | A History of changes | 31 |

Copyright © YASKAWA Europe GmbH

1 General

1.1 Copyright © YASKAWA Europe GmbH

All Rights Reserved

This document contains proprietary information of YASKAWA and is not to be disclosed or used except in accordance with applicable agreements.

This material is protected by copyright laws. It may not be reproduced, distributed, or altered in any fashion by any entity (either internal or external to YASKAWA) except in accordance with applicable agreements, contracts or licensing, without the express written consent of YASKAWA and the business management owner of the material.

For permission to reproduce or distribute, please contact: YASKAWA Europe GmbH, European Headquarters, Hauptstraße 185, 65760 Eschborn, Germany

Tel.: +49 6196 569 300 Fax.: +49 6196 569 398

Email: info@yaskawa.eu.com Internet: www.yaskawa.eu.com



Every effort has been made to ensure that the information contained in this document was complete and accurate at the time of publishing. Nevertheless, the authors retain the right to modify the information.

This customer document describes all the hardware units and functions known at the present time. Descriptions may be included for units which are not present at the customer site. The exact scope of delivery is described in the respective purchase contract.

EC conformity declaration

Hereby, YASKAWA Europe GmbH declares that the products and systems are in compliance with the essential requirements and other relevant provisions. Conformity is indicated by the CE marking affixed to the product.

Conformity Information

For more information regarding CE marking and Declaration of Conformity (DoC), please contact your local representative of YASKAWA Europe GmbH.

Trademarks

VIPA, SLIO, System 100V, System 200V, System 300V, System 300S, System 400V, System 500S and Commander Compact are registered trademarks of YASKAWA Europe GmbH.

SPEED7 is a registered trademark of YASKAWA Europe GmbH.

SIMATIC, STEP, SINEC, TIA Portal, S7-300, S7-400 and S7-1500 are registered trademarks of Siemens AG.

Microsoft and Windows are registered trademarks of Microsoft Inc., USA.

Portable Document Format (PDF) and Postscript are registered trademarks of Adobe Systems, Inc.

All other trademarks, logos and service or product marks specified herein are owned by their respective companies.

VIPA System MICRO General

Copyright © YASKAWA Europe GmbH

Document support

Contact your local representative of YASKAWA Europe GmbH if you have errors or questions regarding the content of this document. If such a location is not available, you can reach YASKAWA Europe GmbH via the following contact:

YASKAWA Europe GmbH, Ohmstraße 4, 91074 Herzogenaurach, Germany

Fax: +49 9132 744 29 1204

Email: Documentation.HER@yaskawa.eu.com

Technical support

Contact your local representative of YASKAWA Europe GmbH if you encounter problems or have questions regarding the product. If such a location is not available, you can reach the YASKAWA customer service via the following contact:

YASKAWA Europe GmbH,

European Headquarters, Hauptstraße 185, 65760 Eschborn, Germany

Tel.: +49 6196 569 500 (hotline) Email: support@yaskawa.eu.com General VIPA System MICRO

About this manual

1.2 About this manual

Objective and contents

The manual describes the power supply (PS) that can be used in the VIPA System MICRO. Described are construction, application and technical data.

| Product | Order no. | as of HW state: |
|--------------------------------|-----------|-----------------|
| PS M07 DC24V, 1.5A_AC120V-240V | M07-2BA00 | 01 |

Target audience

The manual is targeted at users who have a background in automation technology.

Structure of the manual

The manual consists of chapters. Every chapter provides a self-contained description of a specific topic.

Guide to the document

The following guides are available in the manual:

- An overall table of contents at the beginning of the manual
- References with page numbers

Availability

The manual is available in:

- printed form, on paper
- in electronic form as PDF-file (Adobe Acrobat Reader)

Icons Headings

Important passages in the text are highlighted by following icons and headings:



DANGER!

Immediate or likely danger. Personal injury is possible.



CAUTION!

Damages to property is likely if these warnings are not heeded.



Supplementary information and useful tips.

VIPA System MICRO General

Safety instructions

1.3 Safety instructions

Warning symbol on the housing



DANGER!

There is a warning symbol on the housing of the power supply. This indicates that all safety instructions listed in this manual must be observed before commissioning!

Intended use



DANGER!

Failure to comply with the specification may affect the protective functions of the system!

The power supply is constructed and produced for:

- the DC 24V supply of components.
- operation within the environmental conditions specified in the technical data
- the installation on a 35mm mounting rail in a control cabinet, which provides protection against fire, environmental influences and mechanical impact
- industrial applications



DANGER!

This device is not certified for applications in

in explosive environments (EX-zone)

Documentation

The manual must be available to all personnel in the

- project design department
- installation department
- commissioning
- operation



CAUTION!

The following conditions must be met before using or commissioning the components described in this manual:

- Hardware modifications should only be carried out when the system has been disconnected from power!
- Installation and hardware modifications only by properly trained personnel.
- The national rules and regulations of the respective country must be satisfied (installation, safety, EMC ...)

Disposal

National rules and regulations apply to the disposal of the unit!

Safety information for users

2 Basics and mounting

2.1 Safety information for users

Handling of electrostatic sensitive modules

VIPA modules make use of highly integrated components in MOS-Technology. These components are extremely sensitive to over-voltages that can occur during electrostatic discharges. The following symbol is attached to modules that can be destroyed by electrostatic discharges.



The Symbol is located on the module, the module rack or on packing material and it indicates the presence of electrostatic sensitive equipment. It is possible that electrostatic sensitive equipment is destroyed by energies and voltages that are far less than the human threshold of perception. These voltages can occur where persons do not discharge themselves before handling electrostatic sensitive modules and they can damage components thereby, causing the module to become inoperable or unusable. Modules that have been damaged by electrostatic discharges can fail after a temperature change, mechanical shock or changes in the electrical load. Only the consequent implementation of protection devices and meticulous attention to the applicable rules and regulations for handling the respective equipment can prevent failures of electrostatic sensitive modules.

Shipping of modules

Modules must be shipped in the original packing material.

Measurements and alterations on electrostatic sensitive modules When you are conducting measurements on electrostatic sensitive modules you should take the following precautions:

- Floating instruments must be discharged before use.
- Instruments must be grounded.

Modifying electrostatic sensitive modules you should only use soldering irons with grounded tips.




CAUTION!

Personnel and instruments should be grounded when working on electrostatic sensitive modules.

System conception

2.2 System conception

Overview

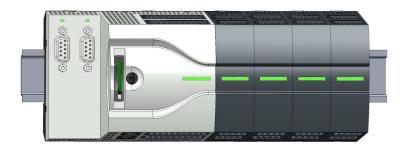

The System MICRO is a modular automation system for assembly on a 35mm mounting rail. By means of periphery modules this system may be adapted matching to your automation tasks. In addition, it is possible to expand your CPU by appropriate interfaces. The wiring complexity is low, because the DC 24V electronic section supply is integrated to the backplane bus and this allows replacement with standing wire.

Components

- CPU
- Extension module
- Periphery module

CPU



With the CPU electronic, input/output components and power supply are integrated to one casing. In addition, up to 8 periphery modules of the System MICRO can be connected to the backplane bus. As head module via the integrated power module for power supply CPU electronic and the I/O components are supplied as well as the electronic of the periphery modules, which are connected via backplane bus. To connect the power supply of the I/O components and for DC 24V electronic power supply of the periphery modules, which are connected via backplane bus, the CPU has removable connectors. By installing of up to 8 periphery modules at the backplane bus of the CPU, these are electrically connected, this means these are assigned to the backplane bus and connected to the DC 24V electronic power supply.

Extension module



By using extension modules you can extend the interfaces of the CPU. The attachment to the CPU is made by plugging on the left side of the CPU. You can only connect one extension module to the CPU at a time.

Dimensions

Power supply



The power supply is mounted on the left side from the DIN rail with the System MICRO modules. It serves for electronics and power supply.


Periphery module



By means of up to 8 periphery modules, you can extend the internal I/O areas. The attachment to the CPU is made by plugging them on the right side of the CPU.

2.3 Dimensions

Dimensions CPU M13C

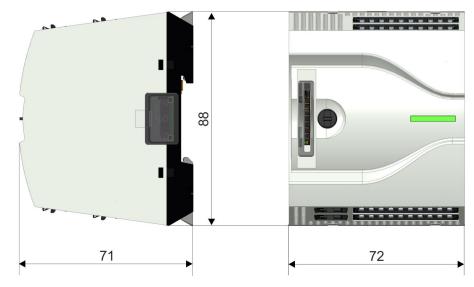


Dimensions in mm

VIPA System MICRO Basics and mounting


Dimensions

Dimensions extension module EM M09

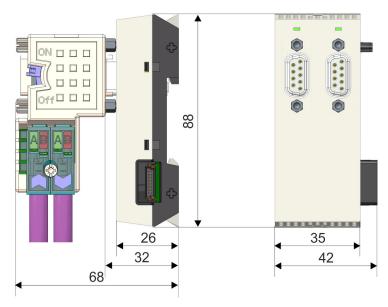


Dimensions in mm

Dimensions power supply

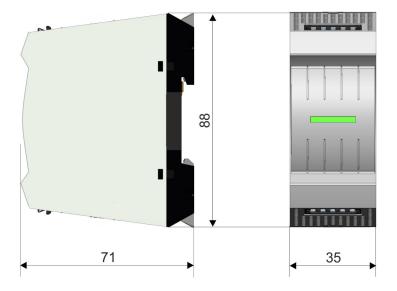

Mounting

Dimensions periphery module

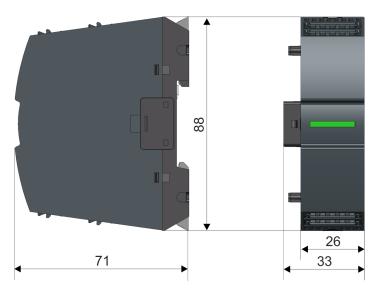

Dimensions in mm


2.4 Mounting



Observe minimum distance!

Ĭ

For operation within the specified nominal values, they must comply with a minimum distance of 30 mm on one side of the module!




Dimensions in mm

Mounting > Mounting with mounting rail

2.4.1 Mounting without mounting rail

Proceeding

You can screw the power supply to the back wall by means of screws via the locking levers. The happens with the following proceeding:

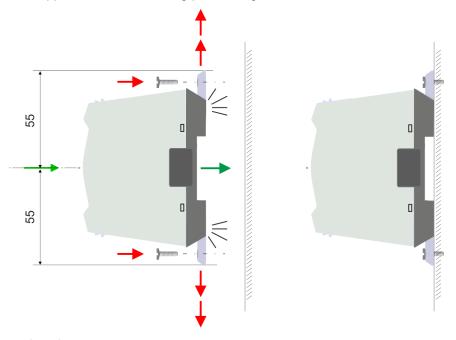


Dimensions in mm

- 1. The power supply has a locking lever on the upper and lower side. Pull these levers outwards as shown in the figure, until these engage 2x audible.
 - ⇒ By this openings on the locking levers get visible.
- 2. Use this openings to fix your power supply to your back wall with appropriate screws. Consider the installation clearances for the power supply.
 - ⇒ The power supply is now mounted and can be wired.

2.4.2 Mounting with mounting rail


Proceeding

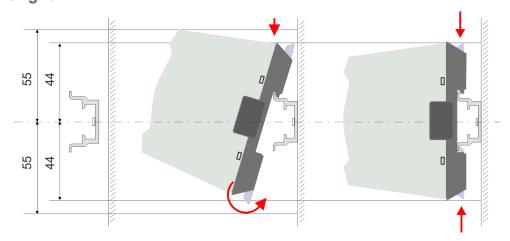

Dimensions in mm

1. Mount the mounting rail. Please consider that a clearance from the middle of the mounting rail of at least 44mm respectively 55mm above and below exists.

Mounting > Mounting with mounting rail




2. The power supply has a locking lever on the upper and lower side. Pull these levers outwards as shown in the figure, until these engage audible.




CAUTION!


It is not allowed to mount the module sideways on the mounting rail, as otherwise the module may be damaged.



2. Plug the power supply from the top onto the mounting rail and turn the power supply downward until it rests on the mounting rail.



4. Move the power supply on the mounting rail at its position.



- **5.** To fix the power supply at the mounting rail, move the locking levers back to the initial position.
 - ⇒ The power supply is now mounted and can be wired.

VIPA System MICRO

Basics and mounting

Wiring > Wiring power supply

2.5 Wiring



DANGER!

Consider strain relief of the supply lines!

Since the plug for the supply lines of the input voltage has no (double) insulation, not permanently fixed supply lines must be relieved from push and pull!



CAUTION!

Consider temperature for external cables!

Cables may experience temperature increase due to system heat dissipation. Thus the cabling specification must be chosen 25°C above ambient temperature!



CAUTION!

Separate insulation areas!


The system is specified for SELV/PELV environment. Devices, which are attached to the system must meet theses specifications. Installation and cable routing other than SELV/PELV specification must be separated from the system's equipment!

2.5.1 Wiring power supply

Connectors

For wiring the power supply has removable connectors. With the wiring of the connectors a "push-in" spring-clip technique is used. This allows a quick and easy connection of your supply lines. The clamping off takes place by means of a screwdriver.

Data



U_{max} 240V AC / 30V DC


 I_{max} 2A

Cross section 0.2 ... 1.5mm² (AWG 24 ... 16)

Stripping length 10mm

Use for wiring rigid wires respectively use wire sleeves. When using stranded wires you have to press the release button with a screwdriver during the wiring.


Wiring procedure



- 1 Labeling on the casing
- 2 Release area
- 3 Connection hole for wire
- 4 Pin 1 of the connector is labelled by a white line.

Demounting


Insert wire



The wiring happens without a tool.

- Determine according to the casing labelling the connection position and insert through the round connection hole of the according contact your prepared wire until it stops, so that it is fixed.
 - By pushing the contact spring opens, thus ensuring the necessary contact pressure.

Remove wire



The wire is to be removed by means of a screwdriver with 2.5mm blade width.

- **1.** Press with your screwdriver vertically at the release button.
 - ⇒ The contact spring releases the wire.
- 2. Pull the wire from the round hole.

Fusing



CAUTION!

To protect the power supply lines, you should use a circuit breaker with the following characteristics:

- Rated current at AC 230V: 4A
- Tripping characteristic: C

2.6 Demounting

Remove connector



By means of a screwdriver there is the possibility to remove the connectors e.g. for module exchange with a fix wiring. For this each connector has indentations for unlocking at the top. Unlocking takes place by the following proceeding:

1. Remove connector:

Insert your screwdriver from above into one of the indentations.

Demounting



- 2. Push the screwdriver backwards:
 - ⇒ The connector is unlocked and can be removed.




CAUTION!

Via wrong operation such as pressing the screwdriver downward, the release lever may be damaged.

3. In this way, remove all plugged connectors on the power supply.

Power supply replacement


Replacement on mounting rail



The replacement of the power supply on the mounting rail happens with the following proceeding:

1. Use a screwdriver to pull the locking levers of the power supply outwards until these engage audible.

2. Remove the power supply with a rotation upwards from the mounting rail.



Pull the locking levers of the new power supply outwards until these engage audible. Plug the power supply from the top onto the mounting rail and turn the power supply downward until it rests on the mounting rail.




CAUTION!

It is not allowed to mount the module sideways on the mounting rail, as otherwise the module may be damaged!

Demounting



4. Move the power supply on the mounting rail at its position.



- **5.** To fix the power supply at the mounting rail, move the locking levers back to the initial position.
 - ⇒ The power supply is now mounted and can be wired.





1. Remove the connectors, which are not necessary at the power supply.



- **2.** Plug again the wired connectors.
 - ⇒ Now you can bring your system back into operation.

Installation guidelines

2.7 Installation guidelines

General

The installation guidelines contain information about the interference free deployment of a PLC system. There is the description of the ways, interference may occur in your PLC, how you can make sure the electromagnetic compatibility (EMC), and how you manage the isolation.

What does EMC mean?

Electromagnetic compatibility (EMC) means the ability of an electrical device, to function error free in an electromagnetic environment without being interfered respectively without interfering the environment.

The VIPA components are developed for the deployment in industrial environments and meets high demands on the EMC. Nevertheless you should project an EMC planning before installing the components and take conceivable interference causes into account.

Possible interference causes

Electromagnetic interferences may interfere your control via different ways:

- Electromagnetic fields (RF coupling)
- Magnetic fields with power frequency
- Bus system
- Power supply
- Protected earth conductor

Depending on the spreading medium (lead bound or lead free) and the distance to the interference cause, interferences to your control occur by means of different coupling mechanisms.

There are:

- galvanic coupling
- capacitive coupling
- inductive coupling
- radiant coupling

Basic rules for EMC

In the most times it is enough to take care of some elementary rules to guarantee the EMC. Please regard the following basic rules when installing your PLC.

- Take care of a correct area-wide grounding of the inactive metal parts when installing your components.
 - Install a central connection between the ground and the protected earth conductor system.
 - Connect all inactive metal extensive and impedance-low.
 - Please try not to use aluminium parts. Aluminium is easily oxidizing and is therefore less suitable for grounding.
- When cabling, take care of the correct line routing.
 - Organize your cabling in line groups (high voltage, current supply, signal and data lines).
 - Always lay your high voltage lines and signal respectively data lines in separate channels or bundles.
 - Route the signal and data lines as near as possible beside ground areas (e.g. suspension bars, metal rails, tin cabinet).

Installation guidelines

- Proof the correct fixing of the lead isolation.
 - Data lines must be laid isolated.
 - Analog lines must be laid isolated. When transmitting signals with small amplitudes the one sided laying of the isolation may be favourable.
 - Lay the line isolation extensively on an isolation/protected earth conductor rail directly after the cabinet entry and fix the isolation with cable clamps.
 - Make sure that the isolation/protected earth conductor rail is connected impedance-low with the cabinet.
 - Use metallic or metallised plug cases for isolated data lines.
- In special use cases you should appoint special EMC actions.
 - Consider to wire all inductivities with erase links.
 - Please consider luminescent lamps can influence signal lines.
- Create a homogeneous reference potential and ground all electrical operating supplies when possible.
 - Please take care for the targeted employment of the grounding actions. The grounding of the PLC serves for protection and functionality activity.
 - Connect installation parts and cabinets with your PLC in star topology with the isolation/protected earth conductor system. So you avoid ground loops.
 - If there are potential differences between installation parts and cabinets, lay sufficiently dimensioned potential compensation lines.

Isolation of conductors

Electrical, magnetically and electromagnetic interference fields are weakened by means of an isolation, one talks of absorption. Via the isolation rail, that is connected conductive with the rack, interference currents are shunt via cable isolation to the ground. Here you have to make sure, that the connection to the protected earth conductor is impedancelow, because otherwise the interference currents may appear as interference cause.

When isolating cables you have to regard the following:

- If possible, use only cables with isolation tangle.
- The hiding power of the isolation should be higher than 80%.
- Normally you should always lay the isolation of cables on both sides. Only by means of the both-sided connection of the isolation you achieve high quality interference suppression in the higher frequency area. Only as exception you may also lay the isolation one-sided. Then you only achieve the absorption of the lower frequencies. A one-sided isolation connection may be convenient, if:
 - the conduction of a potential compensating line is not possible.
 - analog signals (some mV respectively μA) are transferred.
 - foil isolations (static isolations) are used.
- With data lines always use metallic or metallised plugs for serial couplings. Fix the isolation of the data line at the plug rack. Do not lay the isolation on the PIN 1 of the plug bar!
- At stationary operation it is convenient to strip the insulated cable interruption free and lay it on the isolation/protected earth conductor line.
- To fix the isolation tangles use cable clamps out of metal. The clamps must clasp the isolation extensively and have well contact.
- Lay the isolation on an isolation rail directly after the entry of the cable in the cabinet. Lead the isolation further on to your PLC and don't lay it on there again!



CAUTION!

Please regard at installation!

At potential differences between the grounding points, there may be a compensation current via the isolation connected at both sides.

Remedy: Potential compensation line

General data

2.8 General data

| Conformity and approval | | | | | |
|-------------------------|------------|---|--|--|--|
| Conformity | | | | | |
| CE | 2014/35/EU | Low-voltage directive | | | |
| | 2014/30/EU | EMC directive | | | |
| Approval | | | | | |
| UL | - | Refer to Technical data | | | |
| others | | | | | |
| RoHS | 2011/65/EU | Restriction of the use of certain hazardous substances in electrical and electronic equipment | | | |

| Protection of persons and device protection | | | | | | | |
|--|----------------------|-----------------------|--|--|--|--|--|
| Type of protection - IP20 | | | | | | | |
| Electrical isolation | Electrical isolation | | | | | | |
| Safe insulation - between primary and secondary side | | | | | | | |
| Insulation voltage to reference earth | | | | | | | |
| Inputs / outputs - | | | | | | | |
| Protective measures | - | against short circuit | | | | | |

| Environmental conditions to EN 61131-2 | | | | | | | |
|--|---------------|--|--|--|--|--|--|
| Climatic | | | | | | | |
| Storage / transport | EN 60068-2-14 | -40+80°C | | | | | |
| Operation | | | | | | | |
| Horizontal installation hanging | EN 61131-2 | 0+60°C | | | | | |
| Vertical installation | EN 61131-2 | 0+50°C | | | | | |
| Air humidity | EN 60068-2-30 | RH1 (without condensation, rel. humidity 595%) | | | | | |
| Pollution | EN 61131-2 | Degree of pollution 2 | | | | | |
| Installation altitude max. | - | 2000m | | | | | |
| Mechanical | | | | | | | |
| Oscillation | EN 60068-2-6 | 1g, 9Hz 150Hz | | | | | |
| Shock | EN 60068-2-27 | 15g, 11ms | | | | | |

| Mounting conditions | | | | | | |
|---------------------|---|-------------------------|--|--|--|--|
| Mounting place | - | In the control cabinet | | | | |
| Mounting position | - | Horizontal and vertical | | | | |

General data

| EMC | Standard | | Comment | |
|----------------------|---------------------------|---------------|---|--|
| Overvoltage category | voltage category EN 50178 | | III | |
| | UL 61010-1 | | II | |
| Emitted interference | EN 61000-6-4 | | Class A (Industrial area) | |
| Noise immunity | EN 61000-6-2 | | Zone B (Industrial area) | |
| zone B | | EN 61000-4-2 | ESD | |
| | | | 8kV at air discharge (degree of severity 3), | |
| | | | 6kV at contact discharge (degree of severity 3) | |
| | | EN 61000-4-3 | HF field immunity (casing) | |
| | | | 80MHz 1000MHz, 10V/m, 80% AM (1kHz) | |
| | | | 1.4GHz 6.0GHz, 3V/m, 80% AM (1kHz) | |
| | | EN 61000-4-6 | HF conducted | |
| | | | 150kHz 80MHz, 10V, 80% AM (1kHz) | |
| | | EN 61000-4-4 | Burst, degree of severity 3 | |
| | | EN 61000-4-5 | Surge, degree of severity 3 | |
| | | EN 61000-4-11 | Mains voltage dips and interruptions | |

VIPA System MICRO Power supply

Safety instructions

3 Power supply

3.1 Safety instructions

Mounting

For the power supply applies:

- It is mounted together with your System MICRO modules on a DIN rail. In this case, the power supply must always be mounted only on the outer edge of your System MICRO, otherwise the backplane bus is interrupted. The power supply has no connection to the backplane bus.
- When selecting the mounting location, please note that the power supply is sufficiently cooled during operation.

Below are the precautions to take when using the power supply.



CAUTION!

- The power supply may only be installed in dry rooms, which are only accessible by the maintenance engineer!
- The power supply is not approved for use in potentially explosive environments (EX zone)!
- Before you start to work on at the power supply for installation or maintenance, you have to disconnect it from the main power source, i.e. the power line is to be switched off (unplug the plug, with permanent connection the associated fuse must be removed)!
- Only properly qualified electrical staff is allowed to install, connect and/or modify electrical equipment!
- Due to the compact design, the contact and fire protection can not be maintained to ensure sufficient cooling. For this reason, fire protection must be ensured by the construction of the environment of the installed power supply unit (e.g. installation in a control cabinet that complies with the fire protection regulations)!
- Please adhere to the national rules and regulations of the location and/or country where the units are installed (installation, safety precautions, EMC ...).

PS M07 DC24V, 1.5A AC120V-240V

3.2 PS M07 DC24V, 1.5A_AC120V-240V

Properties



- Output current 1.5A
- Rated output voltage DC 24V
- Connection to single-phase AC mains wide-range input AC 120...240V without manual switching
- Protection against short circuit and overload
- Can be used together with System MICRO on the rail
- Safe electrical isolation according to EN 60950
- Overtemperature protection
- Efficiency typ. 90% at I_{nominal}
- Can be used as electronic and power section supply


Ordering data

| Туре | Order number | Description |
|--------------------------------|--------------|---|
| PS M07 DC24V, 1.5A_AC120V-240V | M07-2BA00 | Power supply primary AC 120240V, secondary DC 24V, 1.5A |


Structure



- 1 X1: Terminal DC 24V output
- 2 X3: Terminal AC 120-240V input
- 3 Status bar power module



Schematic diagram







CAUTION!

- The power supplies must be released before installation and repair tasks, i.e. before handling with the power supply or with the cabling you must disconnect current/voltage (pull plug, at fixed connection switch off the concerning fuse)!
- Installation and modifications only by properly trained personnel!

Status bar

| LED | Description |
|-----|---|
| | LEDs off: Input voltage too low, power supply does not start. |
| | LEDs green on: OK: There is no fault and the DC 24V power supply is ensured. |
| | LED red on: Overload: The module is overheated or overloaded (short circuit). |

VIPA System MICRO Power supply

PS M07 DC24V, 1.5A AC120V-240V

Input AC/DC 120...240V

The power supply must be supplied with AC respectively DC voltage via the input socket. A melting fuse protects the input against overload.

| X | Pin | Function | Туре | Description |
|-----|-----|----------|------|---------------|
| X3: | 1 | L / + | I | Input: |
| | | | | L: AC 120240V |
| | | | | +: DC 120240V |
| | 2 | | | n.c. |
| | 3 | | | n.c. |
| | 4 | | | n.c. |
| | 5 | N/M | I | Input |
| | | | | N: AC 120240V |
| | | | | M: DC 120240V |

Line protection

To protect the power supply lines, you should use a circuit breaker with the following characteristics:

- Rated current at AC 230V: 4A
- Tripping characteristic: C



So that the circuit breaker can be easily replaced or reset, this should be mounted easily accessible.

Output DC 24V, 1.5A

The DC 24V output is divided into 2 terminals each. Here you can connect your components, which are to be supplied externally with DC 24V. The DC 24V output is short-circuit proof with an output voltage of DC 24V at a total current of max. 1.5A.

| X | Pin | Function | Туре | Description |
|-----|-----|----------|------|-----------------|
| X1: | 1 | + | 0 | + DC 24V output |
| | 2 | + | 0 | + DC 24V output |
| | 3 | - | 0 | - DC 24V output |
| | 4 | - | 0 | - DC 24V output |
| | 5 | | | n.c. |

Power supply VIPA System MICRO

PS M07 DC24V, 1.5A_AC120V-240V

Operation outside the nominal values



In applications according to CE approval, operation outside the nominal values is permissible, but not in applications according to UL approval!

Regarding the following temperature ranges, operation outside the nominal values is possible

| Output current | 1.5A | 2A | |
|---|----------|----------|----------|
| Input voltage AC | 100 119V | 100 119V | 120 240V |
| Ambient temperature (horizontal installation) | 0 55°C | 0 35°C | 0 45°C |
| Ambient temperature (vertical installation) | 0 50°C | 0 30°C | 0 40°C |
| | | | |
| Output current | 1.5A | 2 | A |
| Input voltage DC | 110 119V | 110 119V | 120 345V |
| Ambient temperature (horizontal installation) | 0 55°C | 0 35°C | 0 45°C |
| Ambient temperature (vertical installation) | 0 50°C | 0 30°C | 0 40°C |

Technical data

3.3 Technical data

| Order no. | M07-2BA00 |
|--|--------------------------|
| Туре | PS M07 |
| Module ID | |
| Technical data power supply | |
| Input voltage (rated value) | AC 120240V |
| Input voltage (permitted range) | AC 90264 V |
| Mains frequency (rated value) | 5060 Hz |
| Mains frequency (permitted range) | 4763 Hz |
| Input current (at 120 V) | 0.9 A |
| Input current (at 230 V) | 0.6 A |
| Inrush current (at 25 °C) | 30 A |
| l²t | |
| Power consumption typ. | 41 W |
| Output voltage (rated value) | 24 V |
| Output current (rated value) | 1.5 A |
| Power supply parallel switchable | |
| Protect type | short circuits, overload |
| Ripple of output voltage (max.), BW=20 MHz | 25 mV |
| Efficiency typ. | 88 % |
| Power loss typ. | 5 W |
| Status information, alarms, diagnostics | |
| Status display | yes |
| Interrupts | no |
| Process alarm | no |
| Diagnostic interrupt | no |
| Diagnostic functions | no |
| Diagnostics information read-out | none |
| Supply voltage display | none |
| Group error display | none |
| Channel error display | none |
| Housing | |
| Material | PC / PPE GF10 |
| Mounting | Profile rail 35 mm |
| Mechanical data | |
| Dimensions (WxHxD) | 35 mm x 88 mm x 71 mm |
| Net weight | 155 g |

Power supply VIPA System MICRO

Technical data

| Order no. | M07-2BA00 |
|------------------------------|-----------------|
| Weight including accessories | 155 g |
| Gross weight | 170 g |
| Environmental conditions | |
| Operating temperature | 0 °C to 60 °C |
| Storage temperature | -40 °C to 80 °C |
| Certifications | |
| UL certification | yes |
| KC certification | in preparation |

VIPA System MICRO Appendix

Appendix

Content

VIPA System MICRO History of changes

A History of changes

| Rev. | Changes |
|-------|-------------------------|
| 20-02 | The manual was created. |